



REV	DESCRIPTION	BY	DATE	APPR
A	ECN #26431	JLS	06/17/2005	AM


- NOTES: UNLESS OTHERWISE SPECIFIED:**
1. APPLICABLE STANDARDS AND SPECIFICATIONS: ASME Y14.5M-1994 DIMENSIONING AND TOLERANCING.
 2. DIMENSIONS AND VALUES IN BRACKETS ARE SI UNITS AND ARE GIVEN FOR REFERENCE ONLY. EQUIPMENT WILL BE DESIGNED AND MANUFACTURED USING ENGLISH UNITS ONLY.
 3. LOCAL CODES MAY REQUIRE ADDITIONAL FRONT CLEARANCE BEYOND 36".
 4. ANCHOR BOLT HOLES MUST BE AT LEAST 7.5 INCHES FROM THE EDGE OF THE SLAB.
 5. MOUNTING AND CONNECTIONS SHOWN FOR REFERENCE ONLY. SEE INSTALLATION MANUAL FOR MOUNTING AND CONNECTION DETAILS.

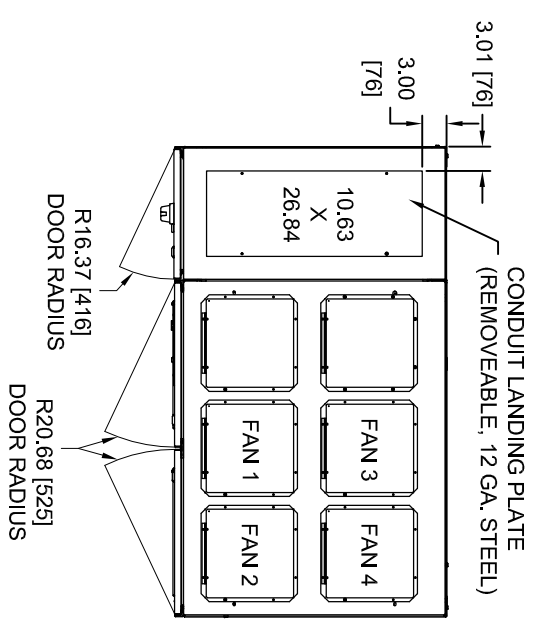

TOP VIEW

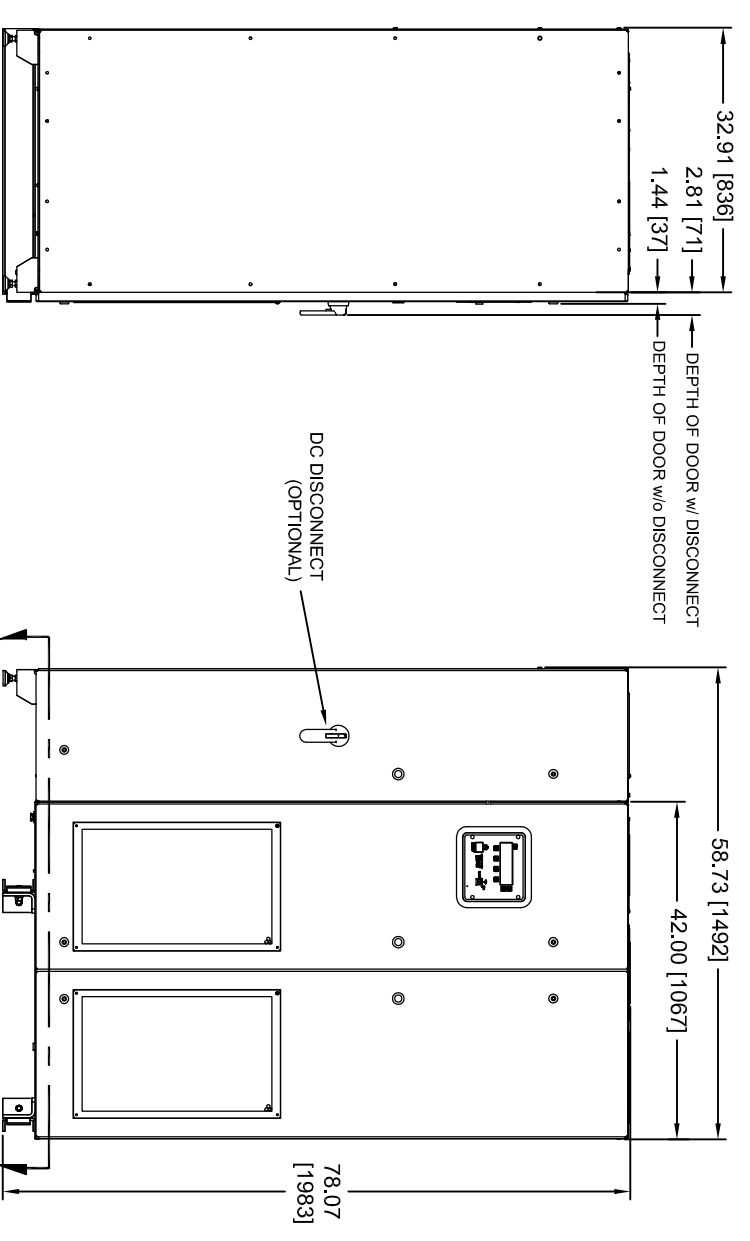

FRONT ELEVATION VIEW

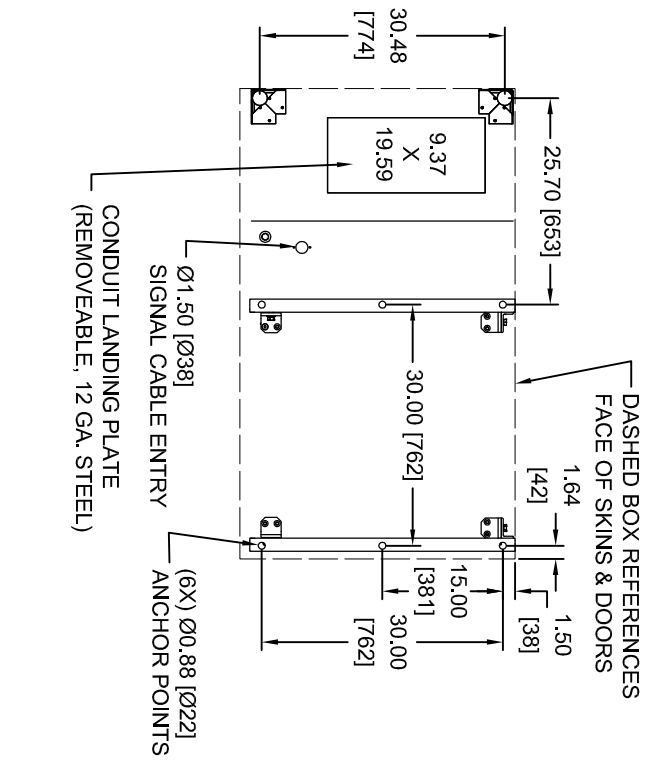

SECTION A-A MOUNTING DETAILS

LEFT SIDE VIEW

ROTATING MACHINERY
 CABINETS MUST BE ANCHORED IN ACCORDANCE TO SPECIFICATIONS GIVEN IN THE INSTALLATION MANUAL.
 NO OTHER ANCHORING METHOD IS ACCEPTABLE.

ACTIVE POWER, INC. CONFIDENTIAL. THIS DOCUMENT AND THE INFORMATION CONTAINED HEREIN ARE CONFIDENTIAL AND NOT TO BE COPIED OR REPRODUCED IN ANY MANNER WITHOUT THE EXPRESS WRITTEN CONSENT OF ACTIVE POWER, INC.		UNLESS OTHERWISE SPECIFIED, ALL DIMENSIONS IN INCHES & SHAPE EDGES, TOLERANCES ARE:	
THIRD ANGLE PROJECTION		DO NOT SCALE DRAWING	
MATERIAL: SEE NOTES		APPROVALS: JLS	
FINISH: SEE NOTES		DATE: 06/17/05	
ANGLES: ±.5°		DESIGNED: AM	
TITLES:		TITLE:	
B		CLEANSOURCE DC OUTLINE, BOTTOM ENTRY	
64042-AP		CSDDC-250	
SCALE: NONE		ACTIVE POWER® AUSTIN, TEXAS	
SHEET 1 OF 1		BY: JLS	
NONE		DATE: 06/17/2005	
NONE		APPR: AM	