



| REV | DESCRIPTION | BY | DATE | APPR |
|-----|-------------|-----|------------|------|
| A | ECN #26439 | JLS | 06/17/2005 | AM |


- NOTES:** UNLESS OTHERWISE SPECIFIED:
1. APPLICABLE STANDARDS AND SPECIFICATIONS: ASME Y14.5M-1994 DIMENSIONING AND TOLERANCING.
 2. DIMENSIONS AND VALUES IN BRACKETS ARE SI UNITS AND ARE GIVEN FOR REFERENCE ONLY. EQUIPMENT WILL BE DESIGNED AND MANUFACTURED USING ENGLISH UNITS ONLY.
 3. LOCAL CODES MAY REQUIRE ADDITIONAL FRONT CLEARANCE BEYOND 36".
 4. ANCHOR BOLT HOLES MUST BE AT LEAST 7.5 INCHES FROM THE EDGE OF THE SLAB.
 5. MOUNTING AND CONNECTIONS SHOWN FOR REFERENCE ONLY. SEE INSTALLATION MANUAL FOR MOUNTING AND CONNECTION DETAILS.

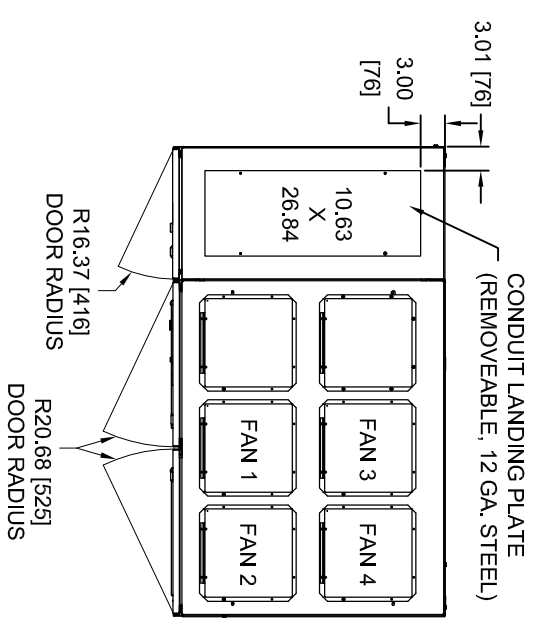


TOP VIEW

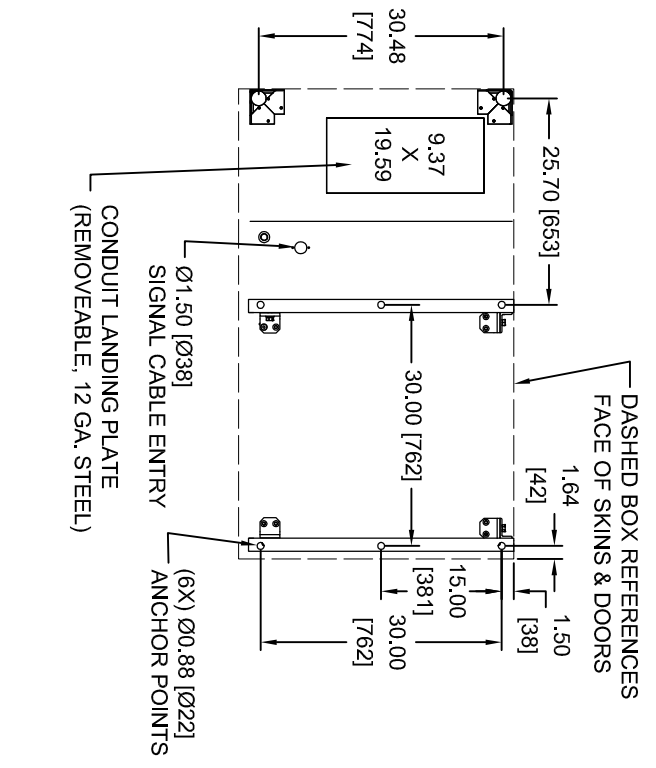

SECTION A-A MOUNTING DETAILS

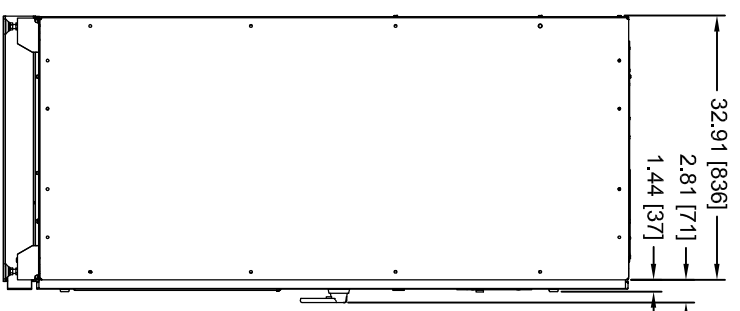

LEFT SIDE VIEW

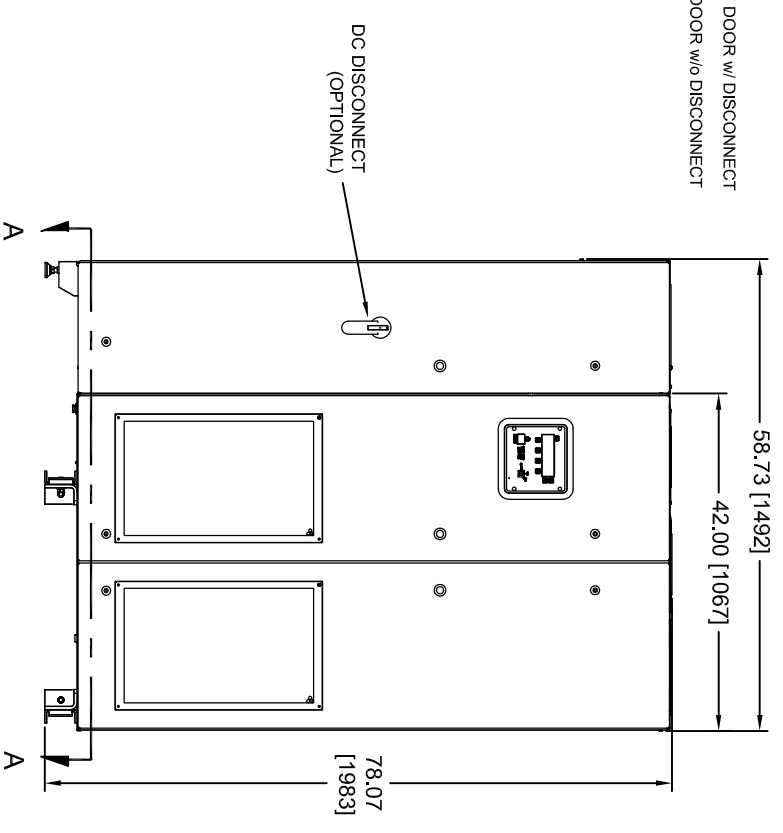

FRONT ELEVATION VIEW

ROTATING MACHINERY
 CABINETS MUST BE ANCHORED IN ACCORDANCE TO SPECIFICATIONS GIVEN IN THE INSTALLATION MANUAL.
 NO OTHER ANCHORING METHOD IS ACCEPTABLE.

ACTIVE POWER, INC. CONSENTS TO THE REPRODUCTION OF THIS DOCUMENT AND THE INFORMATION CONTAINED HEREIN FOR PERSONAL USE ONLY. THIS DOCUMENT IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE EXPRESS WRITTEN CONSENT OF ACTIVE POWER, INC.

UNLESS OTHERWISE SPECIFIED, ALL DIMENSIONS IN INCHES & SHAPE ANGLES, TOLERANCES ARE:
 .XX: ±.03
 .XXX: ±.010
 ANGLES: ±.5°

DO NOT SCALE DRAWING
 APPROVALS
 JLS
 DATE
 06/17/05

Active Power® AUSTIN TEXAS
CLEANSOURCE DC
OUTLINE, BOTTOM ENTRY
 CSDC-500
 64046-AP
 SCALE NONE SHEET 1 OF 1